

Reducing the Waste of Active Power by Choosing the Right Reactive Power Source

Sharobiddinov Mirzokhid Shakhobiddin ugli,

Assistant

Fergana Polytechnic Institute,
Uzbekistan, Ferghana

E-mail: m.sharobiddinov@ferpi.uz

Tokhtasinov Saidislomkhon Khasankhon ugli,

Assistant

Fergana Polytechnic Institute,
Uzbekistan, Ferghana

E-mail: s.toxtasinov@ferpi.uz

Annotation: The research work on the correct selection of the place of installation of the reactive power source and reduction of the waste of active power, taking into account the consumption of reactive power in consumers, is covered.

Keywords: quality indicators, reactive power, reactive power condensation, voltage deviation, reactive power balance, inductance, capacitance, active power waste.

Introduction

It is known to us that electricity consumes a part of itself that is transmitted from one place to another. It is known to us from the theoretical literature that it accounts for around 4-7% according to the laws of physics. Now we can see that the loss of electrical energy in modern electrical networks is 3-4 times higher than this indicator. Modern literature shows us that the increase in electricity losses is expressed not only by commercial losses, but also by the fact that now the type of electricity consumers has changed. While the main structure of electrical consumers in front of them was the organization of loads of the active-inductive (RL) type, with the development of technology, there are elements of capacitance (C) in the composition of devices that have entered wide consumption, which in turn has a significant impact on the quality of electrical energy, while at the same time

Light industry enterprises were selected as the object of research.

The novelty of the study. The location of the installation of the reactive power source was investigated and a connection scheme was proposed, in which the power loss was the least.

Given the reactive power consumption, an algorithm for calculating power losses was developed.

When introducing a device with automatic control of reactive power using innovative devices, a method was based that was economically effective, taking into account the directions of voltage, charge current and reactive power. Reactive power and means of covering it

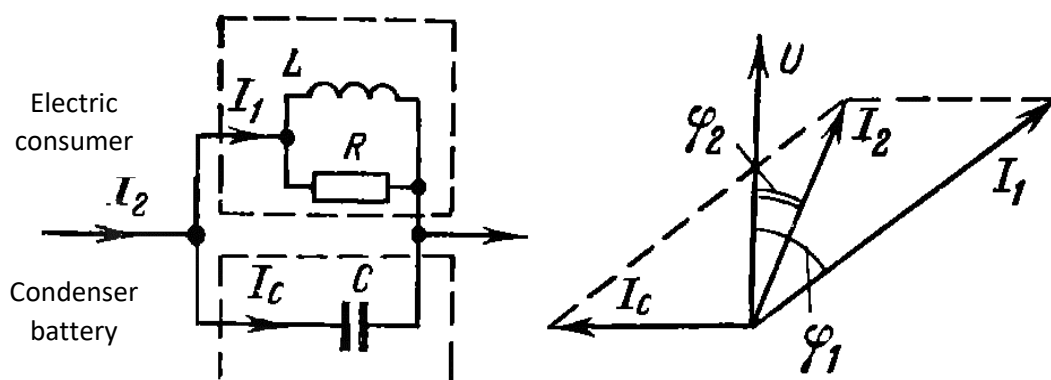


Fig.1.

$$Q_{\Delta} = \omega CU^2 10^{-3} \quad (1.1)$$

The reactive power of a three-phase capacitor block connected by a triangle is determined by the formula (1.1), kVar:

Reactive power compensation methods

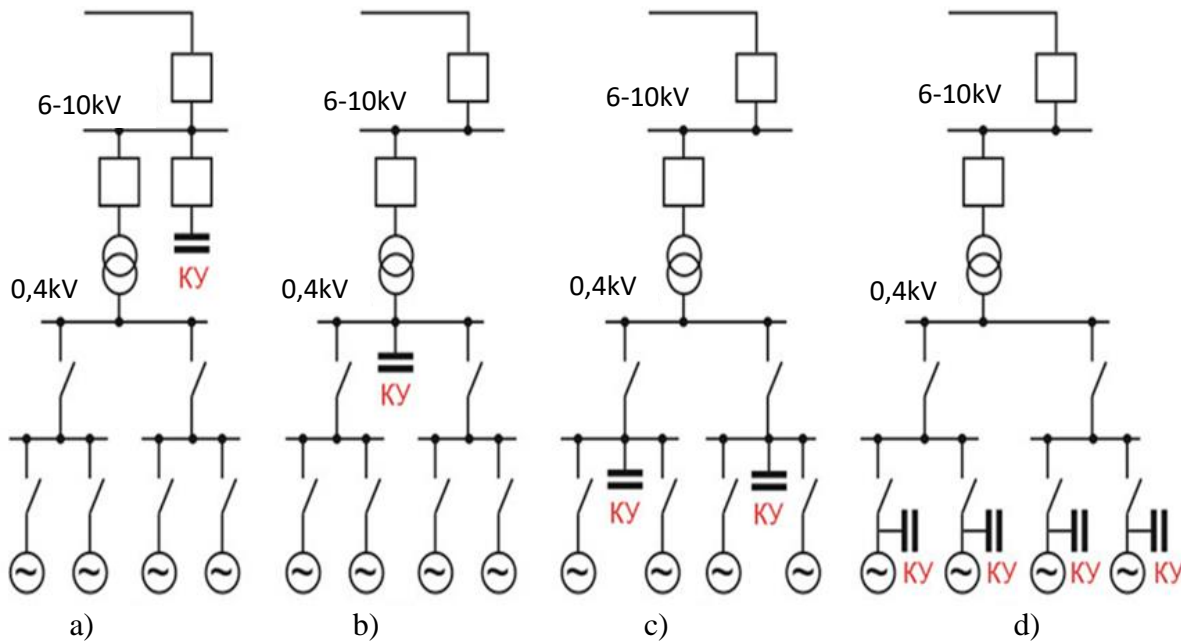


Fig.2 Methods of reactive power compensation in industries.

a) to a centralized high voltage tire b) to a centralized low voltage tire
 c) grooved d) Individual

Capacities and placement of capacitors

Original Power Factor	Corrected Power Factor																				
	0.8	0.91	0.92	0.93	0.94	0.95	0.96	0.97	0.98	0.99	0.9	0.91	0.92	0.93	0.94	0.95	0.96	0.97	0.98	0.99	1.0
0.50	0.982	1.008	1.034	1.060	1.086	1.112	1.139	1.165	1.192	1.220	1.248	1.276	1.306	1.337	1.369	1.403	1.440	1.481	1.529	1.589	1.732
0.51	0.937	0.962	0.989	1.015	1.041	1.067	1.094	1.120	1.147	1.175	1.203	1.231	1.261	1.292	1.324	1.358	1.395	1.436	1.484	1.544	1.687
0.52	0.893	0.919	0.945	0.971	0.997	1.023	1.050	1.076	1.103	1.131	1.159	1.187	1.217	1.248	1.280	1.314	1.351	1.392	1.440	1.500	1.643
0.53	0.850	0.876	0.902	0.928	0.954	0.980	1.007	1.033	1.060	1.088	1.116	1.144	1.174	1.205	1.237	1.271	1.308	1.349	1.397	1.457	1.600
0.54	0.809	0.835	0.861	0.887	0.913	0.939	0.966	0.992	1.019	1.047	1.075	1.103	1.133	1.164	1.196	1.230	1.267	1.308	1.356	1.416	1.559
0.55	0.769	0.795	0.821	0.847	0.873	0.899	0.926	0.952	0.979	1.007	1.035	1.063	1.093	1.124	1.156	1.190	1.227	1.268	1.316	1.376	1.519
0.56	0.730	0.756	0.782	0.808	0.834	0.860	0.887	0.913	0.940	0.968	0.996	1.024	1.054	1.085	1.117	1.151	1.188	1.229	1.277	1.337	1.480
0.57	0.692	0.718	0.744	0.770	0.796	0.822	0.849	0.875	0.902	0.930	0.958	0.986	1.016	1.047	1.079	1.113	1.150	1.191	1.239	1.299	1.442
0.58	0.655	0.681	0.707	0.733	0.759	0.785	0.812	0.838	0.865	0.893	0.921	0.949	0.979	1.010	1.042	1.076	1.113	1.154	1.202	1.262	1.405
0.59	0.619	0.645	0.671	0.697	0.723	0.749	0.776	0.802	0.829	0.857	0.885	0.913	0.943	0.974	1.006	1.040	1.077	1.118	1.166	1.226	1.369
0.60	0.583	0.609	0.635	0.661	0.687	0.713	0.740	0.766	0.793	0.821	0.849	0.877	0.907	0.938	0.970	1.004	1.041	1.082	1.130	1.190	1.333
0.61	0.549	0.575	0.601	0.627	0.653	0.679	0.706	0.732	0.759	0.787	0.815	0.843	0.873	0.904	0.936	0.970	1.007	1.048	1.096	1.156	1.299
0.62	0.516	0.542	0.568	0.594	0.620	0.646	0.673	0.699	0.726	0.754	0.782	0.810	0.840	0.871	0.903	0.937	0.974	1.015	1.063	1.123	1.266
0.63	0.483	0.509	0.535	0.561	0.587	0.613	0.640	0.666	0.693	0.721	0.749	0.777	0.807	0.838	0.870	0.904	0.941	0.982	1.030	1.090	1.233
0.64	0.451	0.474	0.503	0.529	0.555	0.581	0.608	0.634	0.661	0.689	0.717	0.745	0.775	0.806	0.838	0.872	0.909	0.950	0.998	1.068	1.201
0.65	0.419	0.445	0.471	0.497	0.523	0.549	0.576	0.602	0.629	0.657	0.685	0.713	0.743	0.774	0.806	0.840	0.877	0.918	0.966	1.026	1.169
0.66	0.388	0.414	0.440	0.466	0.492	0.518	0.545	0.571	0.598	0.626	0.654	0.682	0.712	0.743	0.775	0.809	0.846	0.887	0.935	0.995	1.138
0.67	0.358	0.384	0.410	0.436	0.462	0.488	0.515	0.541	0.568	0.596	0.624	0.652	0.682	0.713	0.745	0.779	0.816	0.857	0.905	0.965	1.108
0.68	0.328	0.354	0.380	0.406	0.432	0.458	0.485	0.511	0.538	0.566	0.594	0.622	0.652	0.683	0.715	0.749	0.786	0.827	0.875	0.935	1.078
0.69	0.299	0.325	0.351	0.377	0.403	0.429	0.456	0.482	0.509	0.537	0.565	0.593	0.623	0.654	0.686	0.720	0.757	0.798	0.846	0.906	1.049
0.70	0.270	0.296	0.322	0.348	0.374	0.400	0.427	0.453	0.480	0.508	0.536	0.564	0.594	0.625	0.657	0.691	0.728	0.769	0.817	0.877	1.020
0.71	0.242	0.268	0.294	0.320	0.346	0.372	0.399	0.425	0.452	0.480	0.508	0.536	0.566	0.597	0.629	0.663	0.700	0.741	0.789	0.849	992
0.72	0.214	0.240	0.266	0.292	0.318	0.344	0.371	0.397	0.424	0.452	0.480	0.508	0.538	0.569	0.601	0.635	0.672	0.713	0.761	0.821	964
0.73	0.186	0.212	0.238	0.264	0.290	0.316	0.343	0.369	0.396	0.424	0.452	0.480	0.510	0.541	0.573	0.607	0.644	0.685	0.733	0.793	936
0.74	0.159	0.185	0.211	0.237	0.263	0.289	0.316	0.342	0.369	0.397	0.425	0.453	0.483	0.514	0.546	0.580	0.617	0.658	0.706	0.766	909
0.75	0.132	0.158	0.184	0.210	0.236	0.262	0.289	0.315	0.342	0.370	0.398	0.426	0.456	0.487	0.519	0.553	0.590	0.631	0.679	0.739	882
0.76	0.105	0.131	0.157	0.183	0.209	0.235	0.262	0.288	0.315	0.343	0.371	0.399	0.429	0.460	0.492	0.526	0.563	0.604	0.652	0.712	855
0.77	0.079	0.105	0.131	0.157	0.183	0.209	0.236	0.262	0.289	0.317	0.345	0.373	0.403	0.434	0.466	0.500	0.537	0.578	0.626	0.685	829
0.78	0.052	0.078	0.104	0.130	0.156	0.182	0.209	0.235	0.262	0.290	0.318	0.346	0.376	0.407	0.439	0.473	0.510	0.551	0.599	0.659	802
0.79	0.026	0.052	0.078	0.104	0.130	0.156	0.183	0.209	0.236	0.264	0.292	0.320	0.350	0.381	0.413	0.447	0.484	0.525	0.573	0.633	776
0.80	0.000	0.026	0.052	0.078	0.104	0.130	0.157	0.183	0.210	0.238	0.266	0.294	0.324	0.355	0.387	0.421	0.458	0.499	0.547	0.609	750
0.81		0.000	0.026	0.052	0.078	0.104	0.131	0.157	0.184	0.212	0.240	0.268	0.298	0.329	0.361	0.395	0.432	0.473	0.521	0.581	724
0.82			0.000	0.026	0.052	0.078	0.105	0.131	0.158	0.186	0.214	0.242	0.272	0.303	0.335	0.369	0.406	0.447	0.495	0.555	698
0.83				0.000	0.026	0.052	0.079	0.105	0.132	0.160	0.188	0.216	0.246	0.277	0.309	0.343	0.380	0.421	0.469	0.529	672
0.84					0.000	0.026	0.053	0.079	0.106	0.134	0.162	0.190	0.220	0.251	0.283	0.317	0.354	0.395	0.443	0.503	646
0.85						0.000	0.027	0.053	0.080	0.108	0.136	0.164	0.194	0.225	0.257	0.291	0.328	0.369	0.417	0.477	620
0.86							0.000	0.026	0.053	0.081	0.109	0.137	0.167	0.198	0.230	0.264	0.301	0.342	0.390	0.450	593
0.87								0.000	0.027	0.055	0.083	0.111	0.141	0.172	0.204	0.238	0.275	0.316	0.364	0.424	567
0.88									0.000	0.028	0.056	0.084	0.114	0.145	0.177	0.211	0.248	0.289	0.337	0.397	540
0.89										0.000	0.028	0.056	0.086	0.117	0.149	0.183	0.220	0.261	0.309	0.369	512
0.90											0.000	0.028	0.058	0.089	0.121	0.155	0.192	0.233	0.281	0.341	484
0.91												0.000	0.030	0.061	0.093	0.127	0.164	0.205	0.253	0.313	456
0.92													0.000	0.031	0.063	0.097	0.134	0.175	0.223	0.283	426
0.93														0.000	0.032	0.066	0.103	0.144	0.192	0.252	395
0.94															0.000	0.034	0.071	0.112	0.160	0.220	363
0.95																0.000	0.037	0.079	0.126	0.186	0.329

Fig.3. Multipliers to Determine capacitor kilovars required for power factor correction

Capacitor connection schemes research

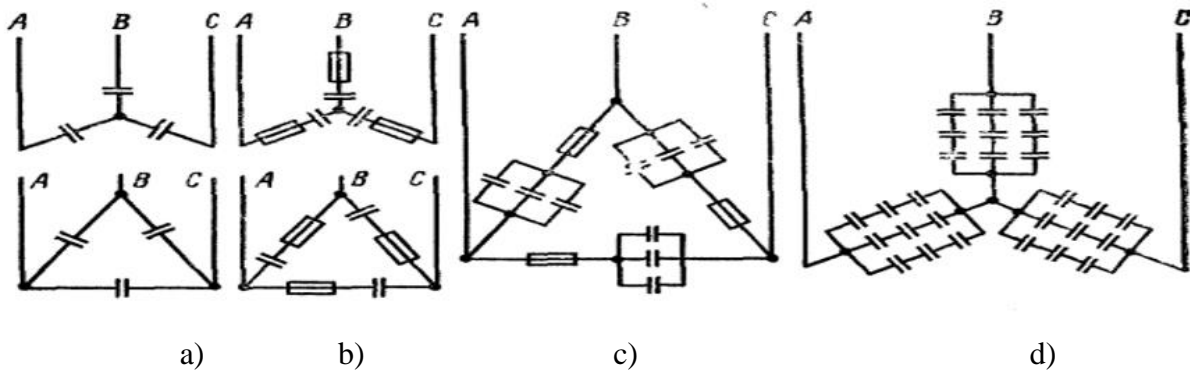


Fig.4. Capacitor connection scheme a,b-star;c,d-triangle

where 3 is the number of condenser phases; k is the coefficient that takes into account the decrease in the power of the capacitors due to the difference in the rated voltage of the network; n is the number of capacitors that must be switched on in Series; m is the number of capacitors to be selected that will be turned on in parallel; Q_n is the Modern case of discharge of capacitors

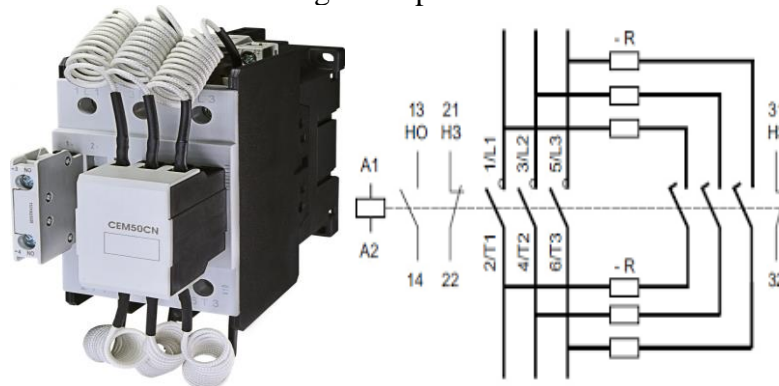


Fig. 5. Modern case of discharge of capacitors

Additional charges for non-compensation of reactive power

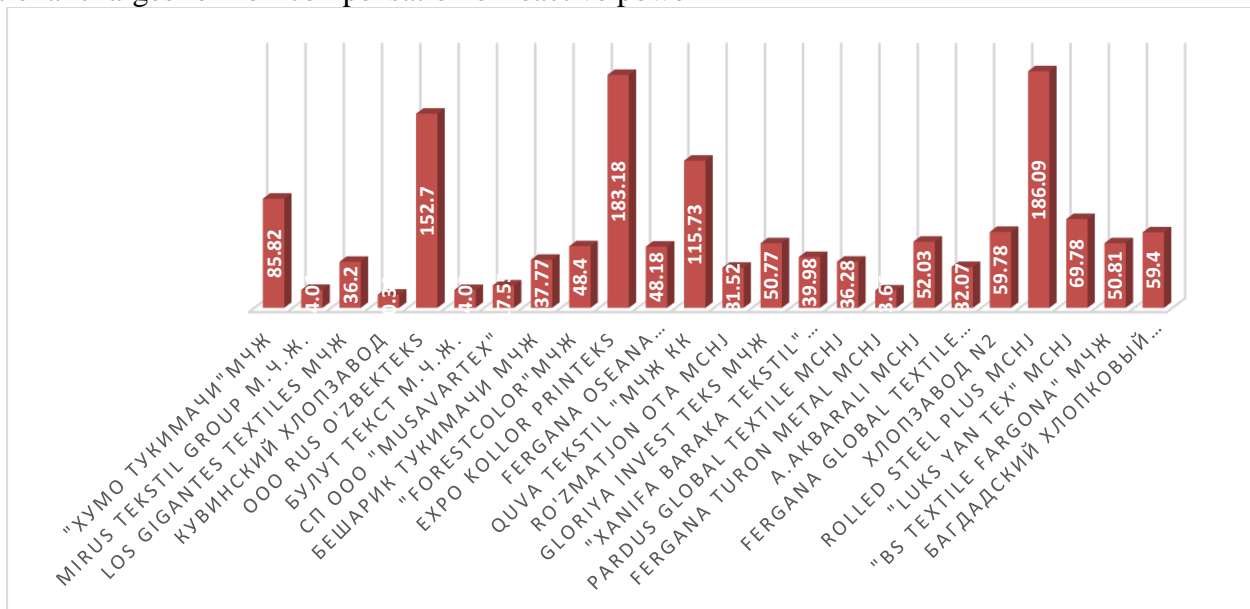


Fig.6. Additional charges for non-compensation of reactive power

Automatic device with a capacity of 200 kW before and after installation active and reactive energy change

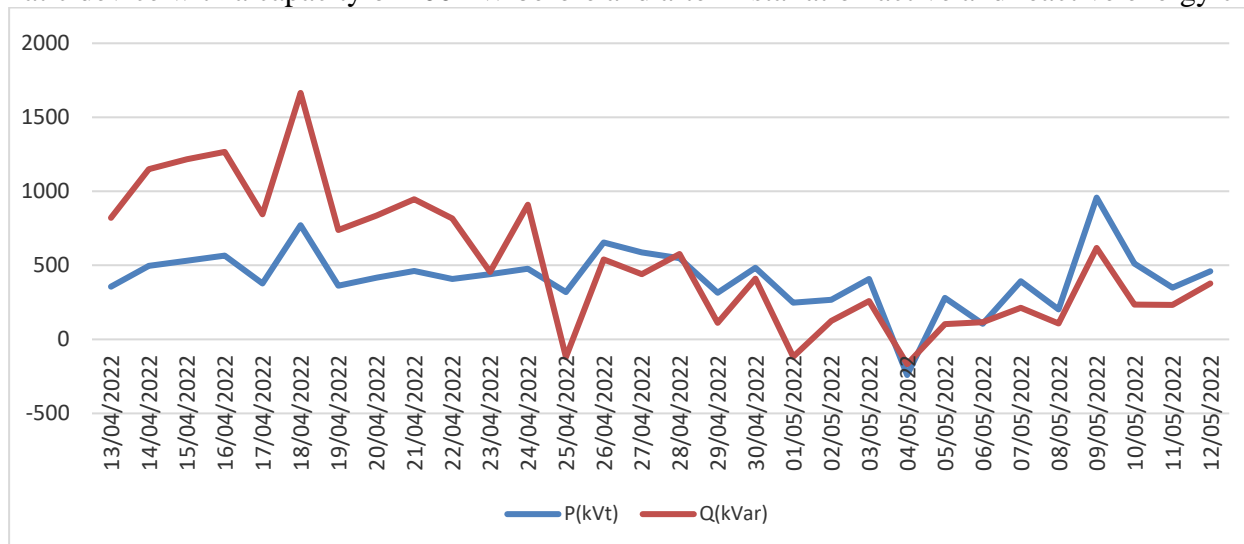


Fig. 7. active and reactive energy change before and after Automatic Device Installation
Determination of quality indicators was carried out on the device "Queen-01".

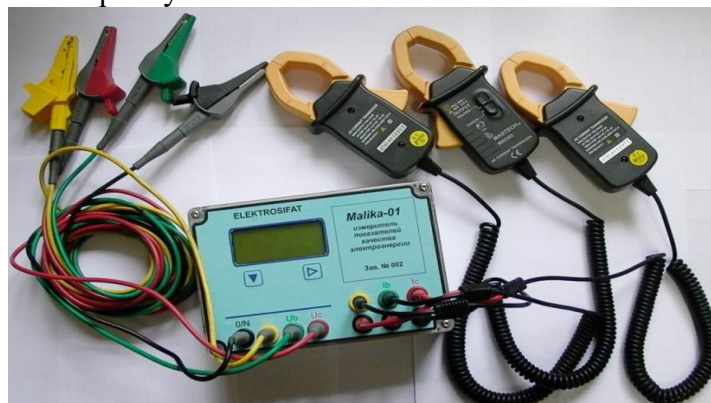


Fig.8. Device "Queen-01".

We can see the voltage change by less than 5% in electrical energy consumers after the automatic start compensation device is installed. And before installation, it can be seen that the voltage value decreases to 10% compared to the nominal state. By keeping the active power coefficient 0.95 in the nominal position, it can be seen that the power wastes are reduced by 10-12%.

In conclusion, modern cases of reducing the waste of active power, reactive power supplies and condenser batteries were studied by the correct selection of the reactive power source. As a result of the studies, capacitor batteries with a reactive power source suitable for the object of research were selected.

References:

1. Kholiddinov I.Kh., Musinova G.F., Kholiddinova M.M. Reactive power management to improve power quality. // ACADEMICIA. An international multidisciplinary research journal. India. 2020. P. 161-167.
2. Холлиддинов И.Х. Внедрения в промышленных предприятиях энергосберегающих автоматических регуляторов реактивной мощности. // Вестник ТашГТУ, 2014. – № 3.– С. 90-94.
3. I.I. Kartashev, V.N. Tul'skiy, R.G. Shamonov and oth.; Power quality management, -M., 2006. -320p "Sanoat korxonalarida sinxron dvigatellar yordamida elektr energiya sifat ko'rsatkichlarini rostlashni tadqiq etish" mavzusidagi, A.A.Qodirov, A.A.To'xtashev, S.S.Komolddinovlarning ilmiy maqolasi uchun

4. K.R. Allaev, I.Kh. Kholiddinov, S.E. Shaismatov, Patent for a useful model of Republic of Uzbekistan. No. FAP 01166. Device for recording additional power losses in case of unbalanced loads in low-voltage power grids. // Agency for Intellectual Property of the Republic of Uzbekistan.
5. И.Х.Холиддинов, М.Ш.Шаробиддинов Анализ снижения потерь в электрических сетях при использовании современных электрических кабелей DOI - 10.32743/UniTech.2022.99.6.13995
6. Abdullayev K. et al. PROTECTIVE PROTECTION AGAINST ELECTRIC SHOCK DURING REPAIR OF ELECTRICAL NETWORKS //Студенческий. – 2019. – №. 6-2. – С. 61-63.
7. Abdullayev A. A. et al. Asinxron dvigatellarda yuqori garmonikalar tasiridan kelib chiqqan isroflar //Involta Scientific Journal. – 2022. – Т. 1. – №. 6. – С. 278-285.
8. Исмоилов И. К., Халилова Ф. А. Регулирование активной и реактивной мощности синхронного генератора при подключении к сети //Universum: технические науки. – 2021. – №. 1-3 (82).
9. Ma'Dievna Y. S. et al. Developing reading comprehension skills of learners //Вопросы науки и образования. – 2019. – №. 7 (53). – С. 193-195.
10. Hakimovich E. A. et al. Automatic adjustment of voltage changes using reactive power //Gospodarka i Innowacje. – 2022. – Т. 29. – С. 277-283.
11. Bokiyev A. A., Zokhidov I. Z. MOBILE ENERGY TECHNOLOGICAL TOOLS BASED ON RENEWABLE ENERGY SOURCES //INTERNATIONAL JOURNAL OF RESEARCH IN COMMERCE, IT, ENGINEERING AND SOCIAL SCIENCES ISSN: 2349-7793 Impact Factor: 6.876. – 2022. – Т. 16. – №. 09. – С. 10-15.
12. Kamoliddinov S. et al. РЕГУЛИРОВКА ИЗМЕНЕНИЯ НАПРЯЖЕНИЯ В УСТРОЙСТВЕ АВТОКОМПЕНСАЦИИ (НА ПРИМЕРЕ ОДНОЙ ФАЗЫ) //Главный редактор: Ахметов Сайранбек Махсутович, д-р техн. наук. – 2022. – С. 49.
13. Akmaljon o'g T. A. et al. Analysis Of Dynamic Stability Of Synchronous Generators In Hydro Power Station In The Electrical Energy System In The Matlab Software //Eurasian Journal of Engineering and Technology. – 2023. – Т. 18. – С. 1-5.
14. Комолддинов С. С. Ў. Кодиров Афзал Ахрор Ўғли, Ашуров Абдулахад Валижон Ўғли, & Тухтасинов Саидисломхон Хасанхон Ўғли (2022) //РЕГУЛИРОВКА ИЗМЕНЕНИЯ НАПРЯЖЕНИЯ В УСТРОЙСТВЕ АВТОКОМПЕНСАЦИИ (НА ПРИМЕРЕ ОДНОЙ ФАЗЫ), (5-9 (98)). – С. 49-54.